

THIS STRUCTURE IS DESIGNED IN ACCORDANCE WITH HB 8630:2004 NZS TRACKS AND OUTDOOR VISITOR STRUCTURES


DESIGN DETAILS:	
SITE USER GROUP	UR, SST, DV
STRUCTURE TYPE	ACCESS
DECK DESIGN LOAD	4.0kPa
FALL HEIGHT	MAX 1.5m

NOTES



BARRIER REQUIRED ON SIDES WHERE THE FALL HEIGHT IS GREATER THAN 1.5m. REFER TO NZS HB8630 FOR DETAILS. REFER TO SHEET 03 FOR BARRIER FIXING DETAIL.

A BUILDING CONSENT IS REQUIRED FOR THE STRUCTURE IF THE FALL HEIGHT IS GREATER THAN 1.0m.

ENSURE BEARING CAPACITY OF POST HOLE IS GREATER THAN 100kPa.

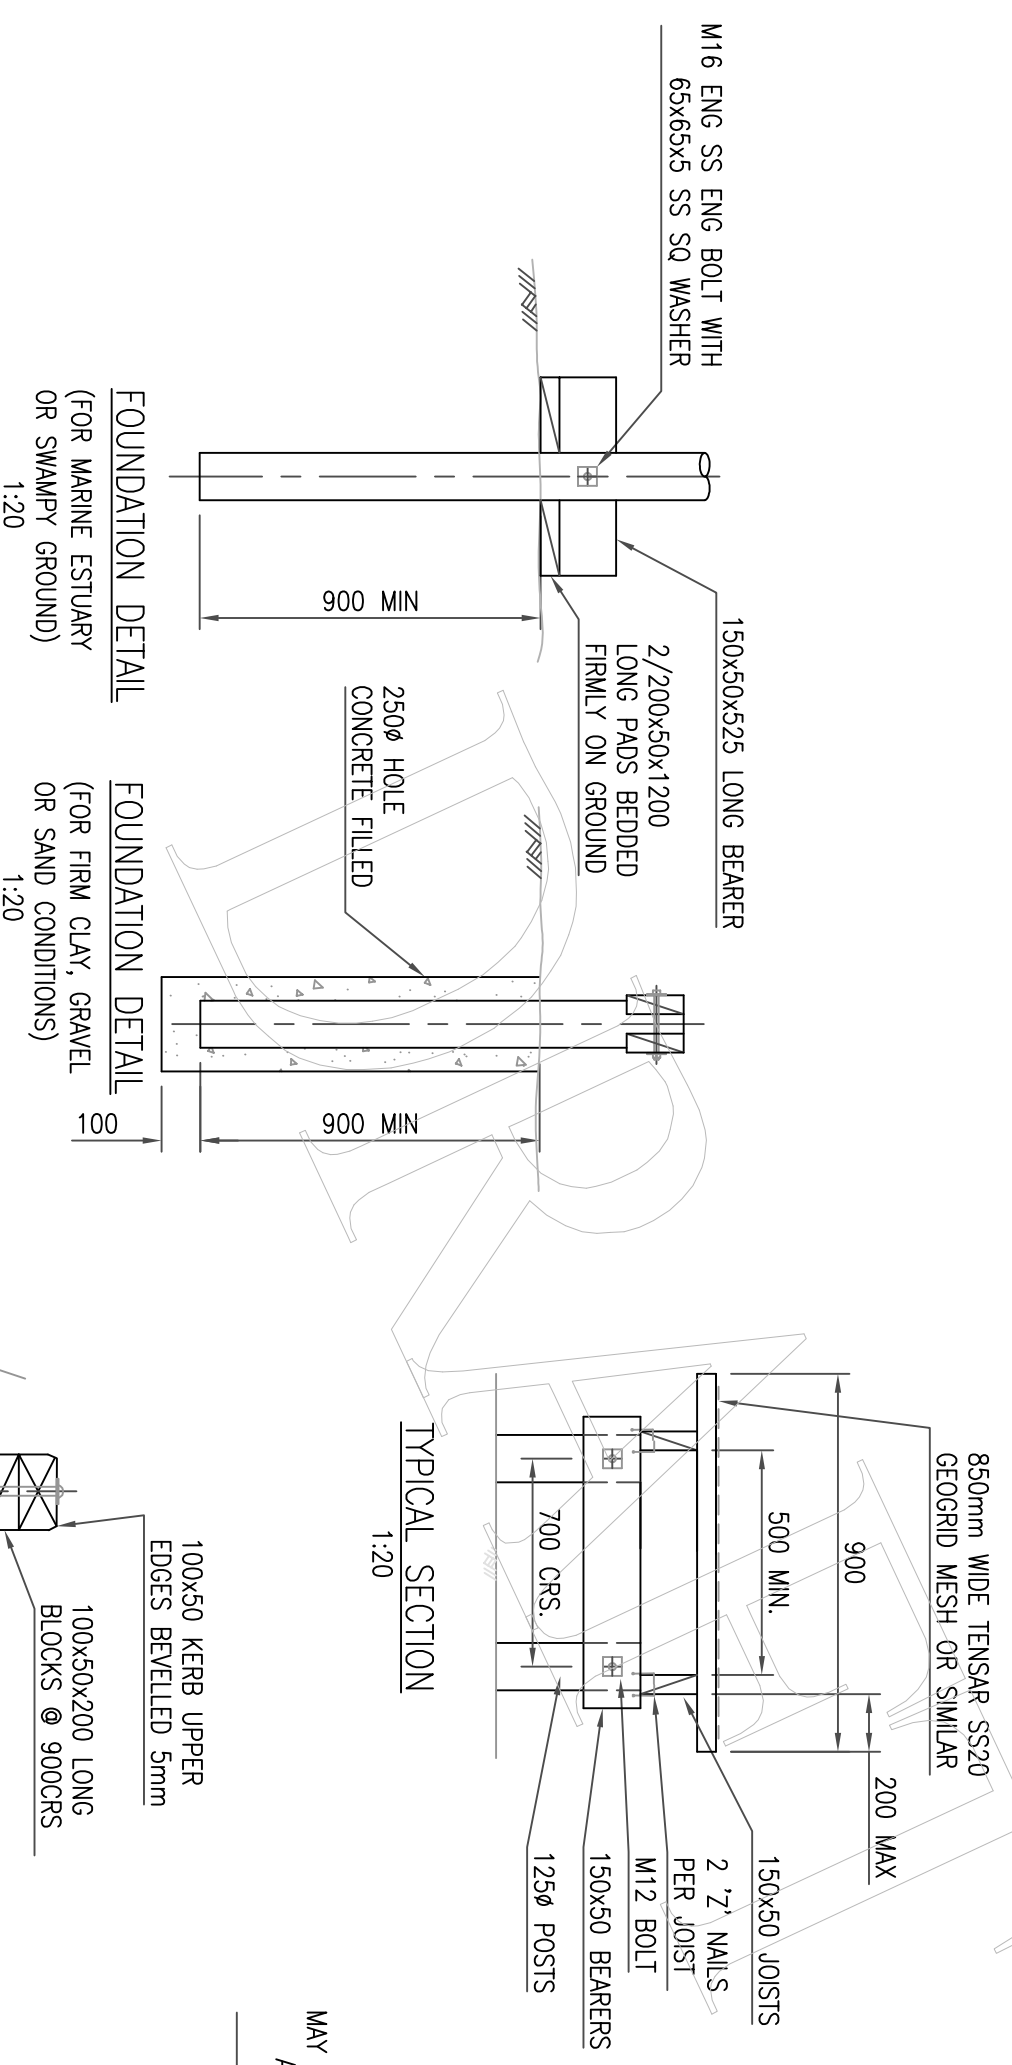

TYPICAL KERB DETAIL
(REQUIRED ON BOARDWALKS WITH DISABLED ACCESS)
1:10

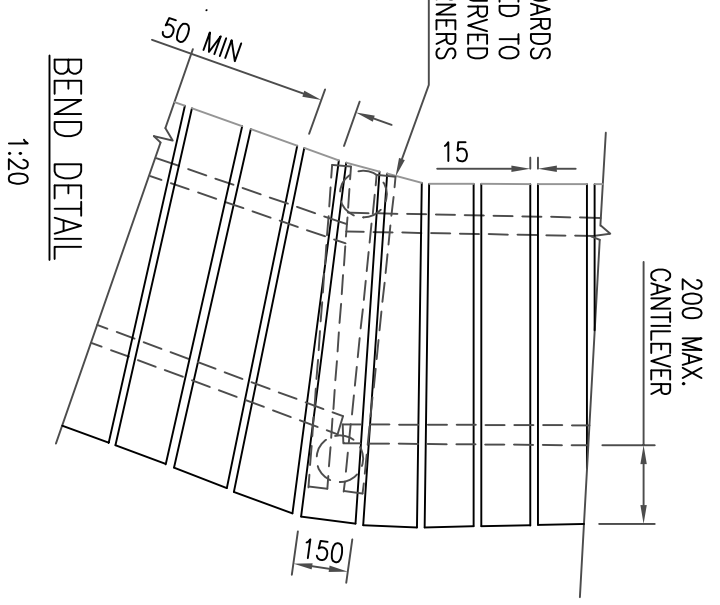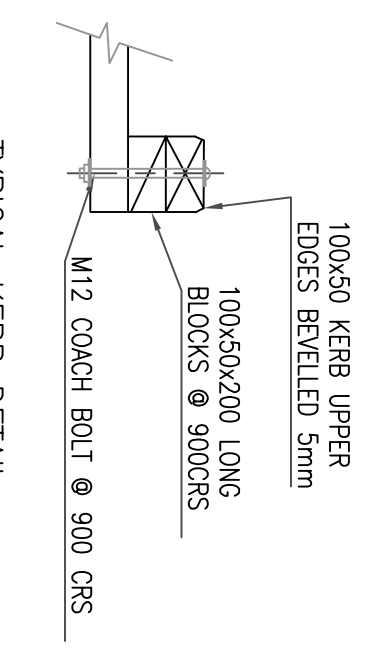

Prepared By:
Frame Group Limited
Fosters House,
Unit 2, Level 2
16 College Hill
Auckland
Phone: 64 9 638 7221
Fax: 64 9 376 0513



Project:
STANDARD DRAWINGS

Title:
900 WIDE BOARDWALK DETAILS

Scale:	AS SHOWN	Job No.:	06/113
Date:	JANUARY 2007	Cad File No.:	BW
Approved:		Drawing No.:	05